



NOTE:

PLUG SHALL BE MECHANICALLY RESTRAINED:

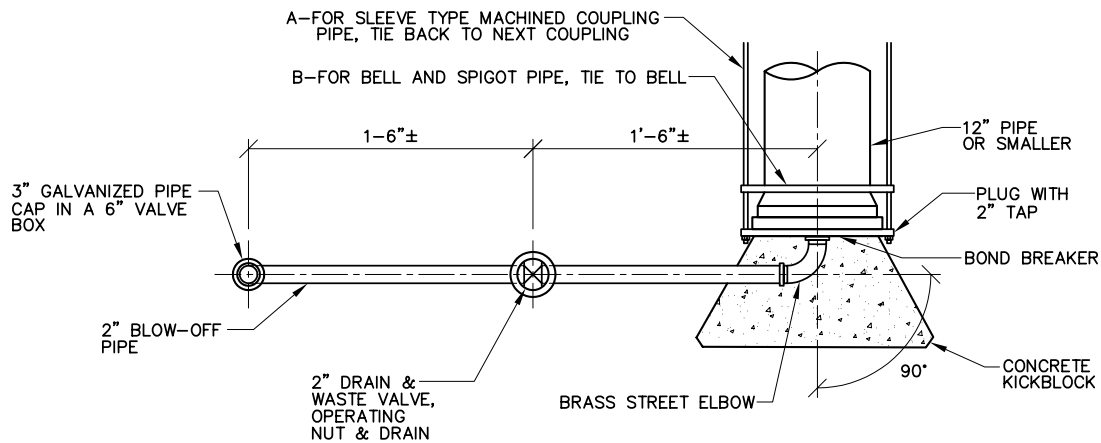

PLAN

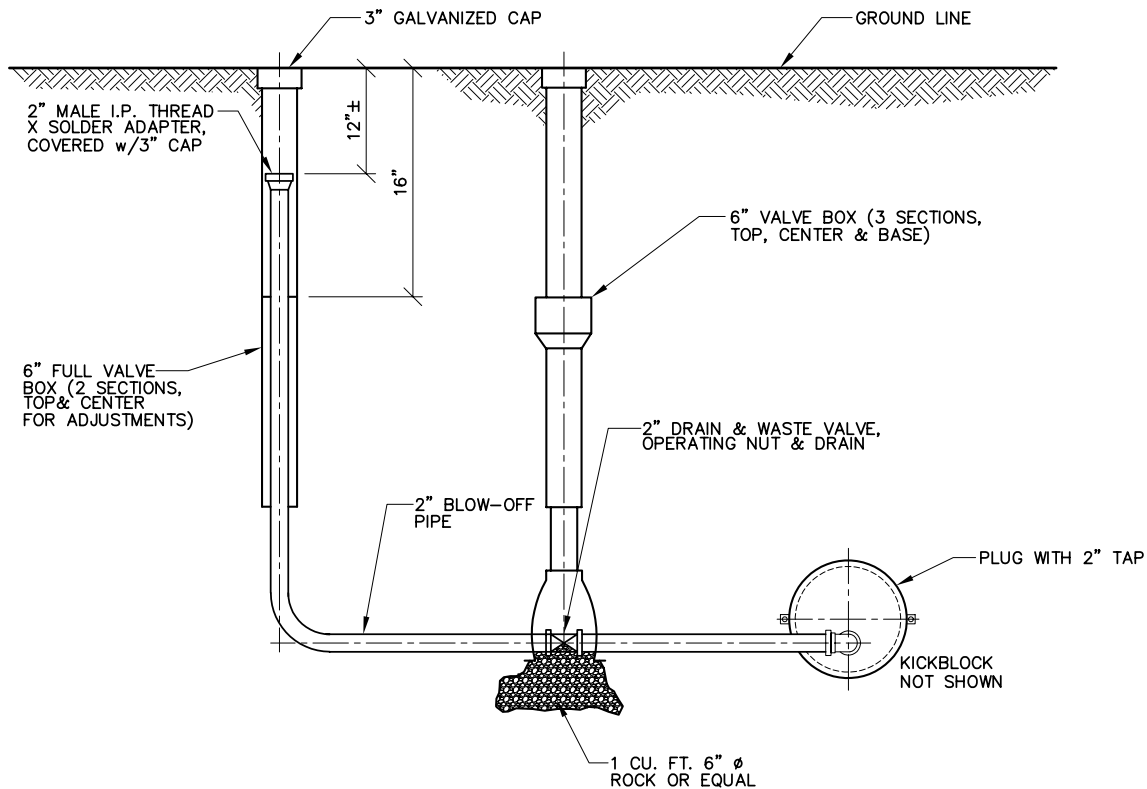

ELEVATION

NOTES:

1. BLOW-OFF PIPE TO BE TYPE K SOFT COPPER OR BRASS.
2. ALLOWED IN MASTER METER AND READ AND BILL DISTRICTS ONLY.

DENVER WATER

1600 West 12th Avenue • Denver, Colorado 80204
Phone (303) 628-6000 • Telecopier No. (303) 628-6851

**BLOW-OFF INSTALLATION
FOR 12" AND SMALLER PIPE**

Scale: NONE Date: JUNE 1995

Drawn: C.B.B. Tr: Ck:

Approved: Dr. 127 No. 35